


Asbestos Register

(Hazardous Materials and Risk Assessment)

School : Bundarra Central School (1415)
Region : New England
State Electorate : Northern Tablelands
Local Government Area : Uralla

Initial Survey : Noel Arnold & Associates : 20 - May - 2008
Reviewed By : AECOM : 29 - Apr - 2016

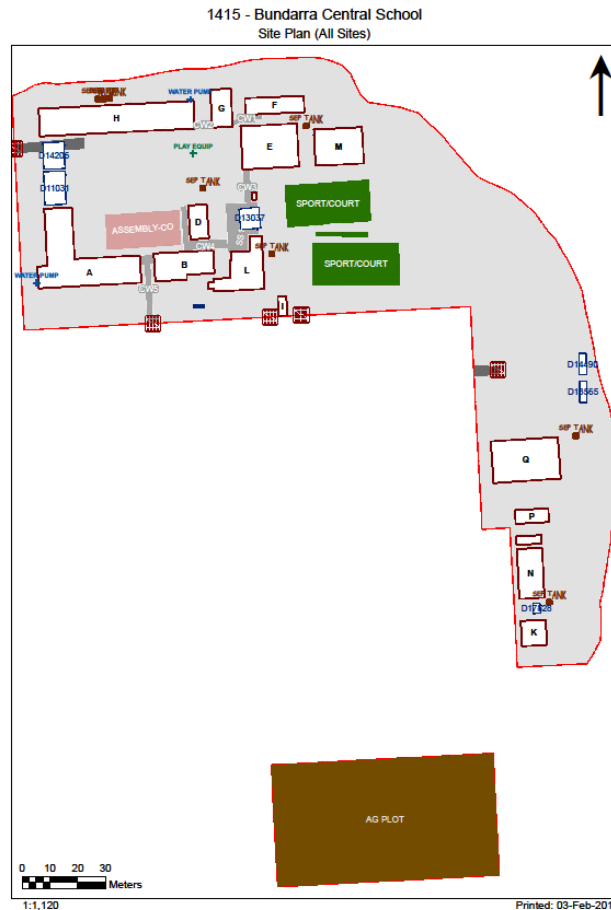

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00A - Administration/Library - 1968 - Brick/Veneer (Brick/Veneer)**Exterior**

Ceiling Voids - Flat Roof	Non Accessible Area - Area inaccessible no access points.					
Underfloor Voids - Packing to Floor Joists	No Asbestos Found					
Eaves Linings	Flat AC Sheeting	15m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00H/R0017/Ceiling Structures/Linings/S2			Chrysotile (White asbestos) , Amosite (Brown asbestos)		

Interior**B00A - R0001 - Personal Effects Storage (6.05 m2)**

Ceiling Structures/Linings	Vermiculite					
	1415/B00A/R0003/Ceiling Structures/Linings/S9					Limited Samples Taken
Vermiculite Ceilings may contain asbestos. Asbestos testing MUST be conducted prior to any disturbance works						

B00A - R0002 - Home Base Store (6.09 m2)

Ceiling Structures/Linings	Vermiculite					
	1415/B00A/R0003/Ceiling Structures/Linings/S9					Limited Samples Taken
Vermiculite Ceilings may contain asbestos. Asbestos testing MUST be conducted prior to any disturbance works						

B00A - R0003 - Home Base (52.42 m2)

Ceiling Structures/Linings	Vermiculite					
	1415/B00A/R0003/Ceiling Structures/Linings/S9					Limited Samples Taken
Vermiculite Ceilings may contain asbestos. Asbestos testing MUST be conducted prior to any disturbance works						

B00A - R0004 - Home Base (52.42 m2)

No Asbestos

B00A - R0005 - Withdrawal Space - 1hb (3.88 m2)

No Asbestos

B00A - R0006 - Home Base Store (6.17 m2)

No Asbestos

B00A - R0007 - Movement (1.7 m2)

No Asbestos

B00A - R0010 - Personal Effects Storage (13.83 m2)

No Asbestos

B00A - R0015 - Movement (3.72 m2)

Ceiling Structures/Linings	Flat AC Sheeting	4m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00H/R0017/Ceiling Structures/Linings/S2			Chrysotile (White asbestos) , Amosite (Brown asbestos)		

B00A - R0016 - Entry Vestibule (8.33 m2)

No Asbestos

B00A - R0017 - Movement (4.57 m2)

No Asbestos

B00A - R0018 - Staff Toilet (3.93 m2)

No Asbestos

B00A - R0019 - Cleaning Distributed Store (4.16 m2)

No Asbestos

B00A - R0020 - Sick Bay (6.54 m2)

No Asbestos

B00A - R0021 - Distribution Board (1.08 m2)

Note: No inspection of live electrical installation.

Electrical Mounting Board	Resinous Board	1Unit	North	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00L/R0012/Electrical Mounting Board/S7			Chrysotile (White asbestos)		

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	
Floor Coverings Res/Textile	Vinyl Tiles	2m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
1415/B00H/R0008/Floor Coverings Res/Textile/S1					Chrysotile (White asbestos)	
B00A - R0022 - Duplicating Workroom (3.91 m2)						
No Asbestos						
B00A - R0023 - Reading Area (53.43 m2)						
No Asbestos						
B00A - R0024 - Reading Area (47.7 m2)						
No Asbestos						
B00A - R0025 - K.L.A. Store (3.87 m2)						
Floor Coverings Res/Textile	Vinyl Tiles	4m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
1415/B00H/R0008/Floor Coverings Res/Textile/S1					Chrysotile (White asbestos)	
B00A - R0026 - Library Office/Workroom (9.93 m2)						
Floor Coverings Res/Textile	Vinyl Tiles	10m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
1415/B00H/R0008/Floor Coverings Res/Textile/S1					Chrysotile (White asbestos)	
B00A - R0027 - Movement (2.97 m2)						
Floor Coverings Res/Textile	Vinyl Tiles	3m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
1415/B00H/R0008/Floor Coverings Res/Textile/S1					Chrysotile (White asbestos)	
B00A - R0028 - External Movement (80.2 m2)						
Ceiling Structures/Linings	Flat AC Sheeting	81m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
1415/B00H/R0017/Ceiling Structures/Linings/S2					Chrysotile (White asbestos) , Amosite (Brown asbestos)	
B00A - R0029 - Home Base (52.56 m2)						
No Asbestos						
B00A - R0030 - Home Base (52.56 m2)						
No Asbestos						

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00B - General Learning - 1968 - Timber (Timber)

Exterior

Underfloor Voids - Packing to Floor Joists	No Asbestos Found					
Ceiling Voids - Raked Ceiling	Non Accessible Area - Height Restriction 3.5m.					
Eaves Linings	Flat AC Sheeting	10m2	North, South	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00B/Eaves Linings/S12					Chrysotile (white asbestos)

Interior

B00B - R0002 - General Learning Space (53.65 m2)

No Asbestos

B00B - R0003 - Special Programs Room (26.79 m2)

No Asbestos

B00B - R0004 - External Movement (40.2 m2)

Ceiling Structures/Linings	Flat AC Sheeting	28m2	West	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00B/R0004/Ceiling Structures/Linings/S13					Chrysotile (white asbestos)

B00B - R0005 - Student Lounge (65.01 m2)

No Asbestos

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00D - Pupil Facilities/Staff Facilities - 1940 - Brick/Block (Brick/Block)**Exterior**

Underfloor Voids - Slab on Ground	Non Accessible Area - Area inaccessible slab to ground, no access points.					
Eaves Linings	Flat AC Sheeting 1415/B00D/Eaves Linings/S18	20m2	Throughout	Minimal Damage (2)	Low (1)	Low Priority (2-3) Chrysotile (white asbestos) , Crocidolite (blue asbestos)
Cement Sheeting Leaning Against Wall	Compressed AC Sheet 1415/B00D/Cement Sheeting Leaning Against Wall/S11					No Asbestos Detected
Ceiling Voids	AC Fragments/Debris 1415/B00D/Ceiling Voids/S19					No Asbestos Detected

Interior**B00D - R0001 - Staff Toilet (2.79 m2)**

Ceiling Structures/Linings	Flat AC Sheeting 1415/B00H/R0017/Ceiling Structures/Linings/S2	3m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3) Chrysotile (White asbestos) , Amosite (Brown asbestos)
----------------------------	---	-----	------------	--------------------	---------	---

B00D - R0002 - Staff Toilet (2.79 m2)

Ceiling Structures/Linings	Flat AC Sheeting 1415/B00H/R0017/Ceiling Structures/Linings/S2	3m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3) Chrysotile (White asbestos) , Amosite (Brown asbestos)
----------------------------	---	-----	------------	--------------------	---------	---

B00D - R0003 - Drinking Facilities (11.17 m2)

Ceiling Structures/Linings	Flat AC Sheeting 1415/B00H/R0017/Ceiling Structures/Linings/S2	12m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3) Chrysotile (White asbestos) , Amosite (Brown asbestos)
----------------------------	---	------	------------	--------------------	---------	---

B00D - R0004 - Toilets - Girls (22.21 m2)

Ceiling Structures/Linings	Flat AC Sheeting 1415/B00H/R0017/Ceiling Structures/Linings/S2	23m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3) Chrysotile (White asbestos) , Amosite (Brown asbestos)
----------------------------	---	------	------------	--------------------	---------	---

Partition Walls (Cubicles)	Compressed AC Sheet 1415/B00D/R0005/Partition Walls (Cubicles)/S5	20m2	North, South	Good Condition (1)	Low (1)	Low Priority (2-3) Chrysotile (White asbestos)
----------------------------	--	------	--------------	--------------------	---------	--

B00D - R0005 - Toilets - Boys (28.42 m2)

Ceiling Structures/Linings	Flat AC Sheeting 1415/B00H/R0017/Ceiling Structures/Linings/S2	29m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3) Chrysotile (White asbestos) , Amosite (Brown asbestos)
----------------------------	---	------	------------	--------------------	---------	---

Partition Walls (Cubicles)	Compressed AC Sheet 1415/B00D/R0005/Partition Walls (Cubicles)/S5	10m2	East, West	Good Condition (1)	Low (1)	Low Priority (2-3) Chrysotile (White asbestos)
----------------------------	--	------	------------	--------------------	---------	--

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00E - Communal Facilities/Pupil Facilities - 1995 - Timber (Timber)

Exterior

Underfloor Voids - Slab on Ground	Non Accessible Area - Area inaccessible slab to ground, no access points.
Ceiling Voids	No Asbestos Found

Interior

B00E - R0001 - Disabled Toilet (4.97 m2)

No Asbestos

B00E - R0002 - Movement (4.78 m2)

No Asbestos

B00E - R0003 - Raised Platform (35.53 m2)

No Asbestos

B00E - R0004 - Movement (5.15 m2)

No Asbestos

B00E - R0005 - Toilets - Boys/Girls (4.04 m2)

No Asbestos

B00E - R0006 - Music Store (10.6 m2)

No Asbestos

B00E - R0007 - Communal Space (135.64 m2)

No Asbestos

B00E - R0008 - Movement (75.8 m2)

No Asbestos

B00E - R0009 - Staff Kitchen (9.76 m2)

No Asbestos

B00E - R0010 - Hall Chair Store (9.92 m2)

No Asbestos

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00F - Communal Facilities/Agricultural Science - 1968 - Steel (Steel)

Exterior

Underfloor Voids - Slab on Ground Non Accessible Area
 - Area inaccessible slab to ground, no access points.

Ceiling Voids - Raked Ceiling No Asbestos Found

Interior

B00F - R0001 - Animal Space (17.96 m2)

No Asbestos

B00F - R0002 - Sports Store (35.68 m2)

No Asbestos

B00F - R0003 - Resources Store (34.52 m2)

No Asbestos

B00F - R0004 - Workshop (34.81 m2)

No Asbestos

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00G - General Learning - 1975 - Timber (Timber)

Exterior

Ceiling Voids - Raked Ceiling	Non Accessible Area - Height Restriction 3.9m.					
Underfloor Voids - Packing to Floor Joists	No Asbestos Found					
Eaves Linings	Flat AC Sheeting 1415/B00G/Eaves Linings/S14					No Asbestos Detected
Infill panel to wall	Flat AC Sheeting 1415/B00G/Infill panel to wall/S15					No Asbestos Detected

Interior

B00G - R0001 - Practical Activities - 1hb (3.71 m2)

No Asbestos

B00G - R0002 - Home Base (56.35 m2)

No Asbestos

B00G - R0003 - Personal Effects Storage (5.38 m2)

No Asbestos

B00G - R0004 - Withdrawal Space - 1hb (10.7 m2)

No Asbestos

B00G - R0005 - External Movement (16.45 m2)

Ceiling Structures/Linings	Flat AC Sheeting	17m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00H/R0017/Ceiling Structures/Linings/S2					Chrysotile (White asbestos) , Amosite (Brown asbestos)

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No				Test Result		

B00H - Technological & Applied Studies/Pupil Facilities - 1975 - Timber (Timber)**Exterior**

Ceiling Voids - Raked Ceiling	Non Accessible Area - Height Restriction HR0021, 3.4m.					
Underfloor Voids - Packing to Floor Joists	No Asbestos Found					
Eaves Linings	Flat AC Sheeting	40m2	North	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00H/R0017/Ceiling Structures/Linings/S2					Chrysotile (White asbestos) , Amosite (Brown asbestos)
Wall Cladding To Dust Extractor Unit	Flat AC Sheeting					
	1415/B00H/Wall Cladding/S4					No Asbestos Detected

Interior**B00H - R0004 - Staff Room Annexe (26.43 m2)**

No Asbestos

B00H - R0005 - Cleaning Distributed Store (12.96 m2)

No Asbestos

B00H - R0006 - Apparatus Store (12.85 m2)

No Asbestos

B00H - R0007 - Laboratory L.S. (79.64 m2)

No Asbestos

B00H - R0008 - Staff Toilet (3.2 m2)

Floor Coverings Res/Textile	Vinyl Tiles	4m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00H/R0008/Floor Coverings Res/Textile/S1					Chrysotile (White asbestos)

B00H - R0009 - Canteen (28.49 m2)

Floor Coverings Res/Textile	Vinyl Tiles	29m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00H/R0008/Floor Coverings Res/Textile/S1					Chrysotile (White asbestos)

B00H - R0010 - Canteen Office/Store (3.28 m2)

Floor Coverings Res/Textile	Vinyl Tiles	4m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00H/R0008/Floor Coverings Res/Textile/S1					Chrysotile (White asbestos)

B00H - R0011 - Distribution Board (0.6 m2)

Note: No inspection of live electrical installation.

Lining To Boxing Unit	Flat AC Sheeting	3m2	Variable positions	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00H/R0011/Lining To Boxing Unit/S10					Chrysotile (White asbestos) , Amosite (Brown asbestos)

Electrical Mounting Board	Resinous Board	1Unit	West	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00L/R0012/Electrical Mounting Board/S7					Chrysotile (White asbestos)

Wall Linings Internal	Flat AC Sheeting	3m2	Throughout, Upper portion	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00H/R0011/Lining To Boxing Unit/S10					Chrysotile (White asbestos) , Amosite (Brown asbestos)

Ceiling Structures/Linings	Flat AC Sheeting	1m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
	1415/B00H/R0011/Lining To Boxing Unit/S10					Chrysotile (White asbestos) , Amosite (Brown asbestos)

B00H - R0012 - Materials Store (17.67 m2)

No Asbestos

B00H - R0013 - Metal Technology Bay (15.84 m2)

No Asbestos

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	
B00H - R0014 - Materials Technology L.S. (68.85 m2)						
No Asbestos						
B00H - R0015 - Welding Area (4.82 m2)						
No Asbestos						
B00H - R0016 - Resource/Project Store (6.43 m2)						
Ceiling Structures/Linings	Flat AC Sheeting	7m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
1415/B00H/R0017/Ceiling Structures/Linings/S2				Chrysotile (White asbestos) , Amosite (Brown asbestos)		
Wall Linings Internal	Flat AC Sheeting	40m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
1415/B00H/R0016/Wall Linings Internal/S3				Chrysotile (White asbestos)		
B00H - R0017 - External Movement (124 m2)						
Ceiling Structures/Linings	Flat AC Sheeting	124m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
1415/B00H/R0017/Ceiling Structures/Linings/S2				Chrysotile (White asbestos) , Amosite (Brown asbestos)		
B00H - R0018 - General Learning Space (22.7 m2)						
No Asbestos						
B00H - R0019 - Kitchen - Type 1 (58.54 m2)						
No Asbestos						
B00H - R0020 - Preparation - Materials (12.26 m2)						
No Asbestos						
B00H - R0021 - Pantry (6.99 m2)						
No Asbestos						
B00H - R0022 - Store (12.16 m2)						
No Asbestos						

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00I - Staff Facilities - 1998 - Fibre Cement Clad (Fibre Cement Clad)

Exterior

Underfloor Voids - Slab on Ground Non Accessible Area
 - Area inaccessible slab to ground, no access points.

Ceiling Voids No Asbestos Found

Interior

B00I - R0001 - Garage/Carport (20.77 m2)

No Asbestos

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00J - Building Services - 2002 - Brick/Block (Brick/Block)

Exterior

Underfloor Voids - Slab on Ground Non Accessible Area
 - Area inaccessible slab to ground, no access points.

Ceiling Voids No Asbestos Found

Interior

B00J - R0001 - General Assistant/Bulk Store (3.29 m2)

No Asbestos

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00K - Agricultural Science - 2004 - Steel (Steel)

Exterior

Underfloor Voids - Slab on Ground Non Accessible Area
 - Area inaccessible slab to ground, no access points.

Ceiling Voids No Asbestos Found

Interior

B00K - R0001 - Garden Store (52.15 m2)

No Asbestos

B00K - R0002 - Movement (25.43 m2)

No Asbestos

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00L - Administration - 1935 - Brick/Block (Brick/Block)**Exterior**

Ceiling Voids - Raked Ceiling	Non Accessible Area - Area inaccessible majority of ceiling space unable to access due to height restrictions. LR0004 accessed.					
Underfloor Voids - Slab on Ground	Non Accessible Area - Area inaccessible slab to ground, no access points.					
Eaves Linings	Flat AC Sheeting 1415/B00C/Eaves Linings/S6					No Asbestos Detected

Interior**B00L - R0001 - Other-Vacant (13.7 m2)**

Ceiling Structures/Linings	Flat AC Sheeting 1415/B00H/R0017/Ceiling Structures/Linings/S2	14m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
						Chrysotile (White asbestos) , Amosite (Brown asbestos)

B00L - R0002 - Other-Vacant (10.25 m2)

In-fill-panel to Fireplace	Flat AC Sheeting 1415/B00L/R0002/In-fill-panel/S8					No Asbestos Detected
Ceiling Structures/Linings	Flat AC Sheeting 1415/B00H/R0017/Ceiling Structures/Linings/S2	11m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
						Chrysotile (White asbestos) , Amosite (Brown asbestos)

B00L - R0003 - Other-Vacant (11.41 m2)

Ceiling Structures/Linings	Flat AC Sheeting 1415/B00H/R0017/Ceiling Structures/Linings/S2	12m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
						Chrysotile (White asbestos) , Amosite (Brown asbestos)

B00L - R0004 - Other-Vacant (6.56 m2)

Man hole cover	Flat AC Sheeting 1415/B00L/R0004/Man hole cover/S17	0.02m2	West	Good Condition (1)	Medium (2)	Low Priority (2-3)
						Chrysotile (white asbestos)

B00L - R0005 - Other-Vacant (1.4 m2)

Wall Linings Internal	Flat AC Sheeting 1415/B00H/R0016/Wall Linings Internal/S3	10m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
						Chrysotile (White asbestos)

B00L - R0006 - Other-Vacant (11.17 m2)

Ceiling Structures/Linings	Flat AC Sheeting 1415/B00H/R0017/Ceiling Structures/Linings/S2	12m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
						Chrysotile (White asbestos) , Amosite (Brown asbestos)

B00L - R0007 - Other-Vacant (22.06 m2)

No Asbestos

B00L - R0008 - Other-Vacant (6.69 m2)

Wall Linings Internal	Flat AC Sheeting 1415/B00H/R0016/Wall Linings Internal/S3	15m2	Throughout, Upper portion	Good Condition (1)	Low (1)	Low Priority (2-3)
						Chrysotile (White asbestos)
Ceiling Structures/Linings	Flat AC Sheeting 1415/B00H/R0017/Ceiling Structures/Linings/S2	7m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
						Chrysotile (White asbestos) , Amosite (Brown asbestos)

B00L - R0009 - Other-Vacant (24.6 m2)

Ceiling Structures/Linings	Flat AC Sheeting 1415/B00H/R0017/Ceiling Structures/Linings/S2	25m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
						Chrysotile (White asbestos) , Amosite (Brown asbestos)

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	
B00L - R0010 - Other-Vacant (15.28 m2)						
Ceiling Structures/Linings	Flat AC Sheeting	16m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
1415/B00H/R0017/Ceiling Structures/Linings/S2				Chrysotile (White asbestos) , Amosite (Brown asbestos)		
B00L - R0011 - Movement (5.84 m2)						
Ceiling Structures/Linings	Flat AC Sheeting	6m2	Throughout	Good Condition (1)	Low (1)	Low Priority (2-3)
1415/B00H/R0017/Ceiling Structures/Linings/S2				Chrysotile (White asbestos) , Amosite (Brown asbestos)		
B00L - R0012 - Movement (22.17 m2)						
Electrical Mounting Board	Resinous Board	1Unit	North	Good Condition (1)	Low (1)	Low Priority (2-3)
1415/B00L/R0012/Electrical Mounting Board/S7				Chrysotile (White asbestos)		
B00L - R0013 - Movement (2.97 m2)						
No Asbestos						
B00L - R0014 - Visitors Office (24.84 m2)						
No Asbestos						
B00L - R0015 - Covered Area (4.31 m2)						
Ceiling Structures/Linings	Flat AC Sheeting					
1415/B00L/R0015/Ceiling Structures/Linings/S16				No Asbestos Detected		

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00M - Library - 2011 - Fibre Cement Clad (Fibre Cement Clad)**Exterior**

Underfloor Voids - Packing to Floor Joists No Asbestos Found

Ceiling Voids No Asbestos Found

Interior**B00M - R0001 - External Movement (34.6 m2)**

No Asbestos

B00M - R0002 - Resource/Toy Space (18.88 m2)

No Asbestos

B00M - R0003 - Multi Media Studio (4.89 m2)

No Asbestos

B00M - R0004 - Reading Area (121.13 m2)

No Asbestos

B00M - R0005 - System Administrators Office (10.95 m2)

No Asbestos

B00M - R0006 - K.L.A. Store (5.88 m2)

No Asbestos

B00M - R0007 - Resource/Toy Space (19.5 m2)

No Asbestos

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00N - Other - 2011 - Steel (Steel)

Exterior

Underfloor Voids - Slab on Ground Non Accessible Area
 - Area inaccessible slab to ground, no access points.

Ceiling Voids No Asbestos Found

Interior

B00N - R0001 - General Learning Space (23.61 m2)

No Asbestos

B00N - R0002 - Workshop Area (124.81 m2)

No Asbestos

B00N - R0003 - Toilets-Disabled (6.21 m2)

No Asbestos

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B000 - Agricultural Science - 2013 - Greenhouse (Greenhouse)

Exterior

Underfloor Voids - Slab on Ground Non Accessible Area
 - Area inaccessible slab to ground, no access points.

Ceiling Voids No Asbestos Found

Interior

B000 - R0001 - Agriculture Covered Area (26.16 m2)

No Asbestos

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00P - General Learning/Technological - 2013 - Metal Shed (Metal Shed)

Exterior

Underfloor Voids - Slab on Ground Non Accessible Area
 - Area inaccessible slab to ground, no access points.

Ceiling Voids No Asbestos Found

Interior

B00P - R0001 - External Movement (18.89 m2)

No Asbestos

B00P - R0002 - Workshop Area (27.64 m2)

No Asbestos

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

B00Q - Mechanical Services - 2014 - Steel (Steel)

Exterior

Underfloor Voids - Slab on Ground Non Accessible Area
 - Area inaccessible slab to ground, no access points.

Ceiling Voids No Asbestos Found

Interior

B00Q - R0001 - External Movement (71.24 m2)

No Asbestos

B00Q - R0002 - Gymnasium (70.59 m2)

No Asbestos

B00Q - R0003 - Workshop Area (142.97 m2)

No Asbestos

B00Q - R0004 - Office/Store (25.83 m2)

No Asbestos

B00Q - R0005 - Lecture Space (44.34 m2)

No Asbestos

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

Demountables

Demountable details as per the AMS records as of 15 Feb 2017.

OS 701 - D11031 - Art Learning Space/Workshop/Store : Placement Date - 26/11/2002

Exterior

Step Treads	Compressed AC Sheet	Assumed Asbestos	1.08 m2
Landing	Compressed AC Sheet	Assumed Asbestos	1.2 m2
Eave Lining	Flat AC Sheet	Assumed Asbestos	14.4 m2

Interior

R1 - Entry

End wall panel	Flat AC Sheet	Assumed Asbestos	18 m2
Ceiling	Flat AC Sheet	Assumed Asbestos	8 m2

R2 - Art Learning Space

End wall panel	Flat AC Sheet	Assumed Asbestos	18 m2
Ceiling	Flat AC Sheet	Assumed Asbestos	73 m2

R3 - Store

Ceiling	Flat AC Sheet	Assumed Asbestos	10 m2
---------	---------------	------------------	-------

OS 841 - D12870 - Boys Toilet : Placement Date - 13/01/2011

Exterior

No Asbestos Found.

Interior

R1 - Toilets-Boys

No Asbestos Found.

OS 600 - D13037 - Learning Unit - Small : Placement Date - 12/02/2008

Exterior

Step Treads	Compressed AC Sheet	Assumed Asbestos	1.08 m2
Landing	Compressed AC Sheet	Assumed Asbestos	1.2 m2
Eave Lining	Flat AC Sheet	Assumed Asbestos	8.64 m2

Interior

R1 - General Learning Space

End wall panel	Flat AC Sheet	Assumed Asbestos	50 m2
Ceiling	Flat AC Sheet	Assumed Asbestos	55 m2

OS 840 - D13392 - Girls Toilet : Placement Date - 13/01/2011

Exterior

No Asbestos Found.

Interior

R1 - Toilets-Girls

No Asbestos Found.

OS 841 - D13565 - Boys Toilet : Placement Date - 1/05/2014

Note: This refurbished demountable may have asbestos present in remnant mastic in window frames.

Exterior

No Asbestos Found.

Interior

R1 - Toilets-Boys

No Asbestos Found.

OS 603 - D14206 - Learning Unit - Standard With P.A.A. A/C : Placement Date - 29/11/2006

Note: This refurbished demountable may have asbestos present in remnant mastic in window frames.

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

Exterior

No Asbestos Found.

Interior

R1 - Learning space/withdrawal/entry

No Asbestos Found.

R2 - Home Base Store

No Asbestos Found.

OS 840 - D14490 - Girls Toilet : Placement Date - 1/05/2014

Exterior

No Asbestos Found.

Interior

R1 - Toilets-Girls

No Asbestos Found.

OS 837 - D17828 - Hcap Shower/Change/Toilet : Placement Date - 1/05/2014

Exterior

Step Treads	Compressed AC Sheet	Assumed Asbestos	1.08 m2
Landing	Compressed AC Sheet	Assumed Asbestos	1.2 m2
Eave Lining	Flat AC Sheet	Assumed Asbestos	2.88 m2

Interior

R1 - Disabled Shower/Toilet

Toilet partitions	Compressed AC Sheet	Assumed Asbestos	12 m2
End wall panel	Flat AC Sheet	Assumed Asbestos	36 m2
Ceiling	Flat AC Sheet	Assumed Asbestos	18 m2

2017

Product	Material Description	Extent	Location Reference	Material Condition	Risk Status	Control Priority
Sample No					Test Result	

Listing of Electronic Attachments as of 22/03/2017

There are no asbestos related file attachment(s) for this school.

2017